

FCS

Capacitive level switch

Capacitive level switch is with simple structure, using syntonic circuit theory, and with strong stability and sensitivity to adjust capacitance, sensitivity is adjustable, suitable for all kinds of solid level measurment. Widely applied in food, chemical products, metallurgy and electric power etc. Also could be used in high temperature, high pressure, strong acid and alkali situations.

Product Series








Operating principle

Regarding the measured item as medium, using sensor to measure the capacitance between sensor and barrel wall, when the sensor is covered by materials, capacitance is increasing, when reaching the matched value set in the inner circuit of switch, circuit will procude resonant high frequency, and to amplify the signal to change actions of switch.


Model sheets




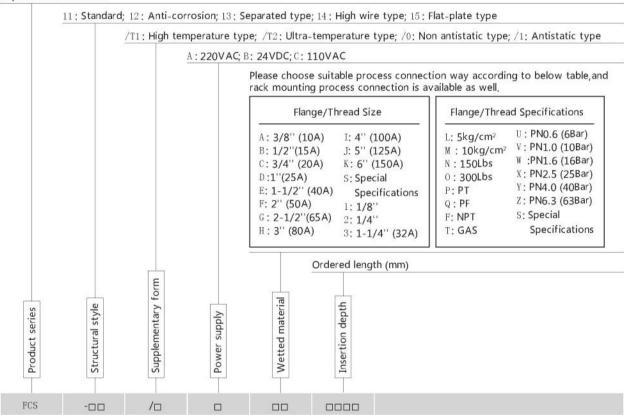



Please kindly advise if explosion-proof is necessary.

Sizes and specifications

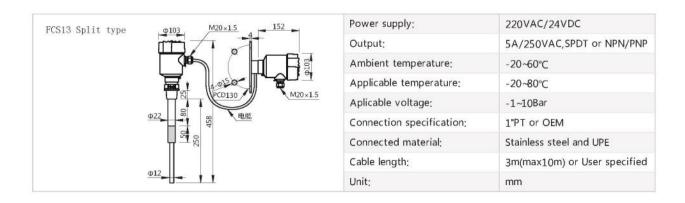


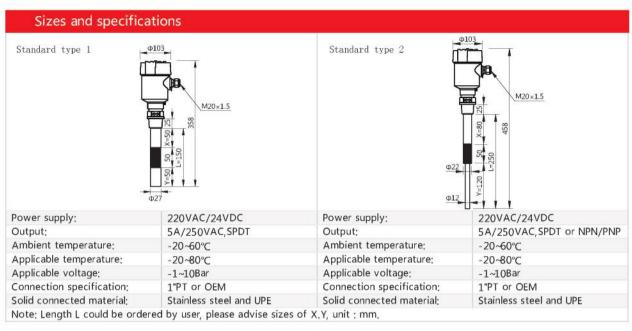


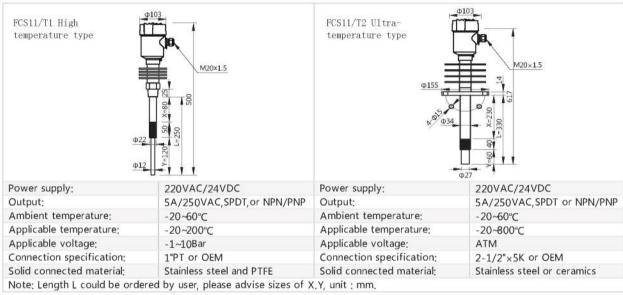

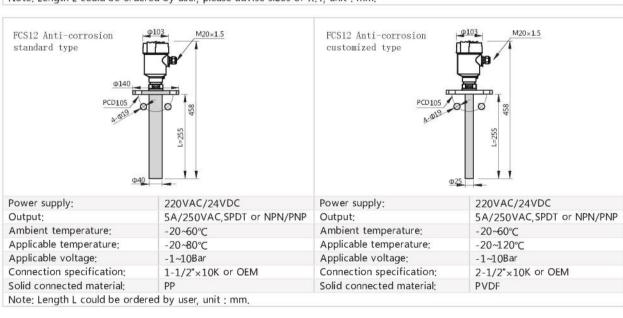


Sizes and specifications FCS14 highwire type FCS11/T1/1 Antistatic high temperature type Ф103 Ф103 M20×1.5 M20×1.5 Power supply: 220VAC/24VDC Power supply: 220VAC/24VDC Output: 5A/250VAC, SPDT or NPN/PNP Output: 5A/250VAC, SPDT or NPN/PNP Ambient temperature: Ambient temperature: -20~60°C -20~60°C Applicable temperature: Applicable temperature: -20~80℃ -20~200°C Aplicable voltage: Aplicable voltage: -1~10Bar -1~10Bar Connection specification: Connection specification: 1-1"PT or OEM 1"PT or OEM Connected material: Stainless steel and UPE Connected material: Stainless steel and PTFE

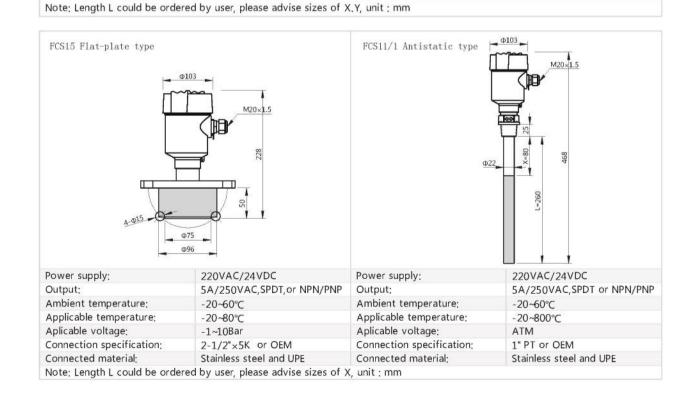





The switch should be downward and to be 20 degree with horizontal line in order to increase the flexibility of the switch, and decrease the damage of switch when baiting




Standard installation, insulated part must insert the bucket for more than 30mm,to avoid the fake action cased by materials in connection pipe and too short distance between connection pipe and sensor bar.




Please note the position of installation when side mounted, if the entrance is not centered, then angle of response and entrance corresponding point should be considered, or it will cause wrong switch action.



When the fluidity gets week, top mounted way of installation could decrease the affect of wrong switch action cased by angle of response of materials.




Flat-plate type installation, please note the thickness between barrel wall and fixed flange can not be more than 25mm, or the switch will cause wrong action.




When it's top mounted, pls consider if the mounted position will enable the sensor stick to contact the position of liquid or products. When it's SP150 highwire installation, pls note the distance between barrel walls should be at least 30mm. Sp160 flat-plate type could be installed under the tank.


Notes of installation and type selection




When the tank has been equipped with vibration device, to avoid the damage to the circuit component in junction box, we suggest to use SP140 solid material level switch.




If installed multi-switches, the distance between each of them is at least 300mm.




If the switch is under fluctuant condition, it should equip with our circuit board with time-delay function to avoid wrong switch action.



Pls dont install close to the entrance, to avoid the solid materials shock the sensor bar, and cause damage of sensor bar, we suggest to install a protective board above the sensor bar.



If the switch is installed to measure the liquid, pls dont install under the entrance, to avoid the liquid washing the switch and cause wrong switch action or be damaged.



The cable outlet of junction box should be downward and must lock the fixed cable side, to avoid damage to inner circuit board.